


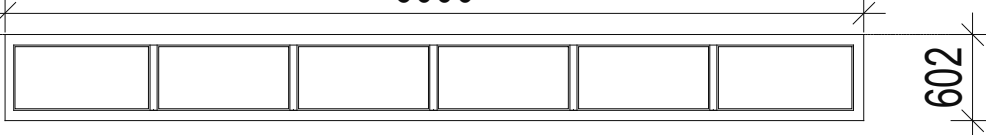


WINDOW SCHEDULE												
	W1			W2			W3			W4		
	1500			533			1500			6000		
												
	TYPE 1	WINDOW NUMBERS	W1	TYPE 2	WINDOW NUMBERS	W2	TYPE 3	WINDOW NUMBERS	W3	TYPE 4	WINDOW NUMBERS	W4
		REQUIRED NO.9			REQUIRED NO. 8					REQUIRED NO. 19		
WINDOW NUMBERS	W1-01,W1-02,W1-03,W1-04,W1-05, W1-07,W1-08,W1-09,W1-10			W2-01,W2-02,W2-03,W2-04,W2-05,W2-06 W2-07,W2-08			W3-01, W3-02,W3-03, W3-04,W3-05, W3-06 W3-07, W3-08,W3-09, W3-10,W3-11, W3-12 W3-13, W3-14,W3-15, W3-16,W3-17, W3-18 W1-06			W4-01, W4-02,W4-03, W4-04,W4-05, W4-06 W4-07, W4-08,W4-09, W4-10,W4-11, W4-12 W4-13, W4-14,W4-15, W4-16		
WINDOW FRAME	Powdercoated aluminium frame			Powdercoated aluminium frame			Powdercoated aluminium frame			Powdercoated aluminium frame		
GLAZING	Flush glazing frame with 6.38mm thick solar sheild glass s10			Flush glazing frame with 6.38mm thick solar sheild glass s10			Flush glazing frame with 6.38mm thick solar sheild glass s10			Flush glazing frame with 6.38mm thick solar sheild glass s10		
ACCESORIES	N/A			N/A			N/A			N/A		

APPLICABLE STANDARDS

The Standard that shall apply in the design, maufacturer and installation of all items in this Schedule shall be **BOS 88:2016 Third Edition** being the "**Glazed aluminium alloy windows and doors for external use - specification**", as published by the Botswana Bureau of Standards.

- Doors and curtain walls are to be assembled from suitable, approved, 1.8mm thick aluminium profiles.
- Windows of standard size are to be assembled from suitable, approved, 1.5mm thick aluminium profiles.
- All joint sealing materials shall comply with the standards, and shall be adequate to prevent air and water leakage.
- All glass shall comply with safety requirements as specified by the Standards.
- All assemblies shall comply with the Safety and Security requirements of the Standards.
- All powder coating shall comply with the Standards and must be UV-resistant and scratch resistant to the minimum standard.
- PREVENTION OF THERMAL CRACKS:** The supplier must ensure the prevention of thermal cracks by adequately polishing all edges and applying all other measures required. Contact between glass and metal must be avoided.

ALL INSTALLATIONS MUST BE TO APPROVED SHOP DRAWINGS.

1 WINDOW SCHEDULE
1:NTS

GENERAL NOTES:

1. NO DIMENSIONS TO BE SCALED.

2. DIMENSIONS TO BE VERIFIED ON SITE BEFORE COMMENCING ANY SITE WORK OR SHOP DRAWINGS.

3. DIMENSIONS ARE TAKEN TO CENTRE LINES OR STRUCTURAL SURFACES AND DO NOT INCLUDE FINISHES EXCEPT WHERE OTHERWISE STATED.

4. THE ARCHITECT IS TO BE NOTIFIED OF ANY DISCREPANCIES BETWEEN THIS DRAWING AND ANY OTHER DRAWING OR CONSTRUCTION DOCUMENTS INCLUDING THOSE ISSUED BY CONSULTANTS AND NOMINATED SUB-CONTRACTORS BEFORE COMMENCING WORK.

5. MINIMUM STRENGTH POF CONCRETE 21Mpa

ISSUED FOR MEASUREMENT PURPOSES

B

Issued for stage 3 coordination

07.02.22

REV.

DESCRIPTION

DATE

CLIENT

SOUTHERN AFRICAN DEVELOPMENT COMMUNITY

JOB TITLE

SADC STANDBY FORCE REGIONAL LOGISTICS DEPOT, AT RASESA, GABORONE, BOTSWANA,

DWG TITLE

VEHICLE MAINTENANCE - WINDOW SCHEDULE

SCALE

AS SHOWN

JOB No.

G649

DATE

JANUARY 2022

DRAWN BY

KT

REV.

B

CHECKED BY

AM

Project Team:

Architect
Quantity Surveyor
Electrical Engineers
Mechanical Engineers
Civil Engineers
Structural Engineers

FMA Architects
Turner & Townsend (Pty) Ltd.
G4 Consulting Engineers (Pty) Ltd.
G4 Consulting Engineers (Pty) Ltd.
Bohokaga Sharrow Botswana (Pty) Ltd.
Bohokaga Sharrow Botswana (Pty) Ltd.

FMA

FMA ARCHITECTS (PTY) LTD.
P.O. BOX 201504 BONTLENG
GABORONE, BOTSWANA.
TEL: 3959812/3 FAX: 3959814
E-MAIL: fmagabs@info.bw

DRWG. No.

G649-SADC/ARCH/2/008 / 1-404